




ENERGY

# Advanced Energy Storage Use Cases

*Michael Kleinberg, PhD.*

*NYSERDA On-Site Power – December 7, 2016*

# About DNV GL

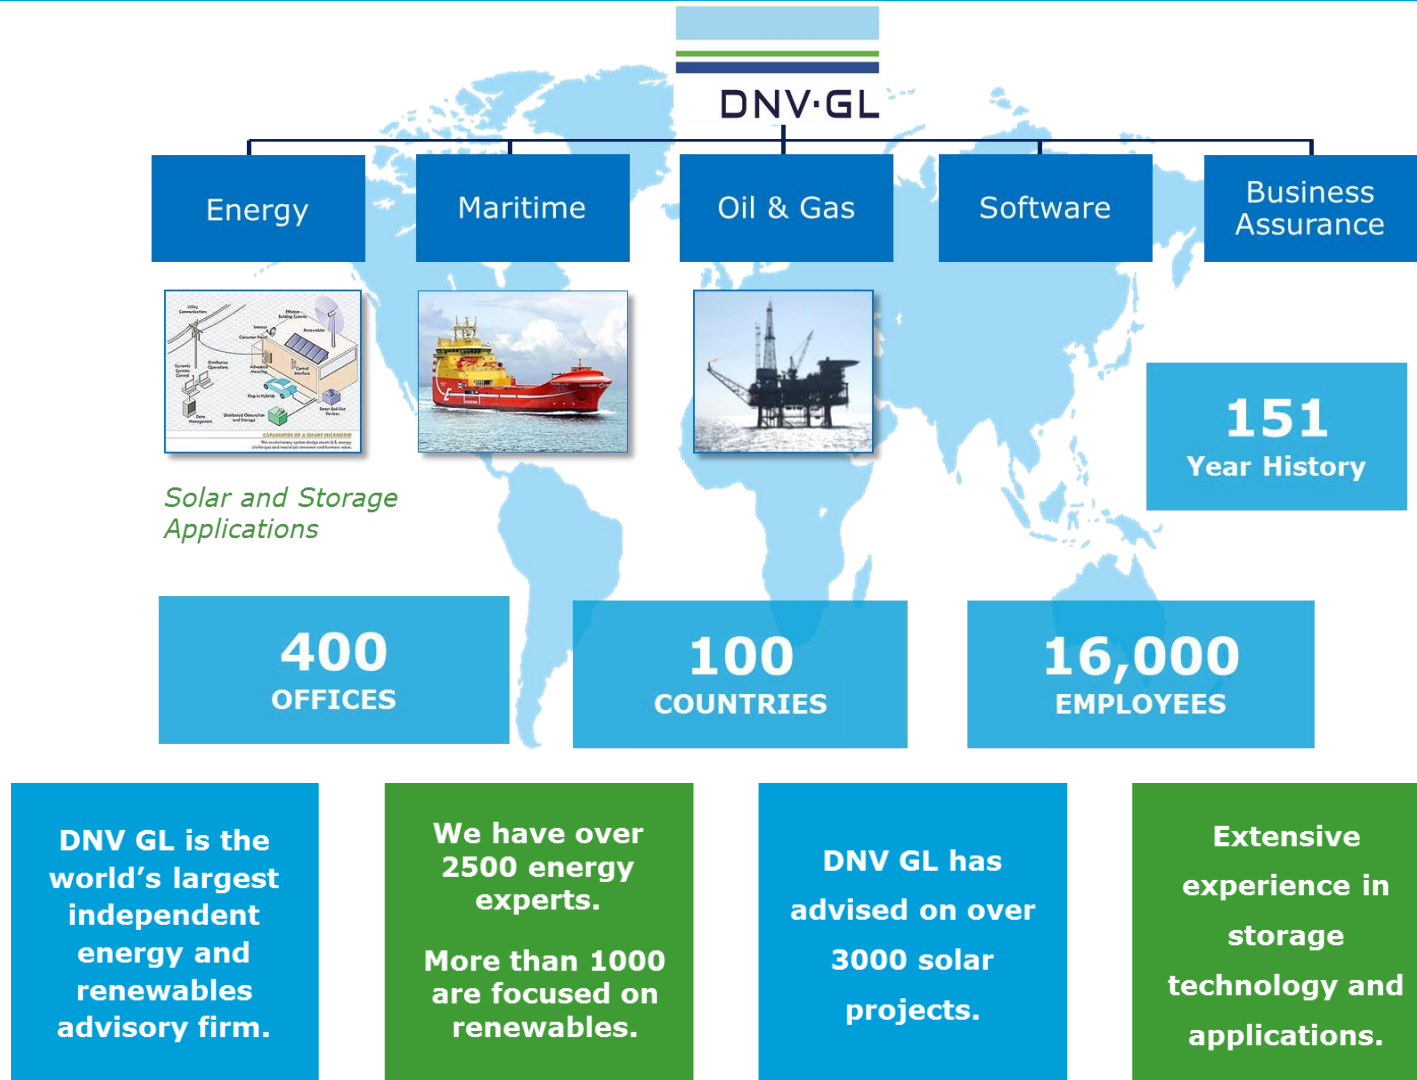

# DNV GL - ARPA-e CHARGES

New battery technologies for the grid require new testing and validation.  
 Past ARPA-e battery technology awardees will be evaluated.

- Task 1: Testing Protocols
- Task 2: Economic Models
- Task 3: Battery Testing
- Task 4: Microgrid Testing
- Task 5: Commercialization




## Partners



## Program Advisory Board



# Capturing the Value of Storage

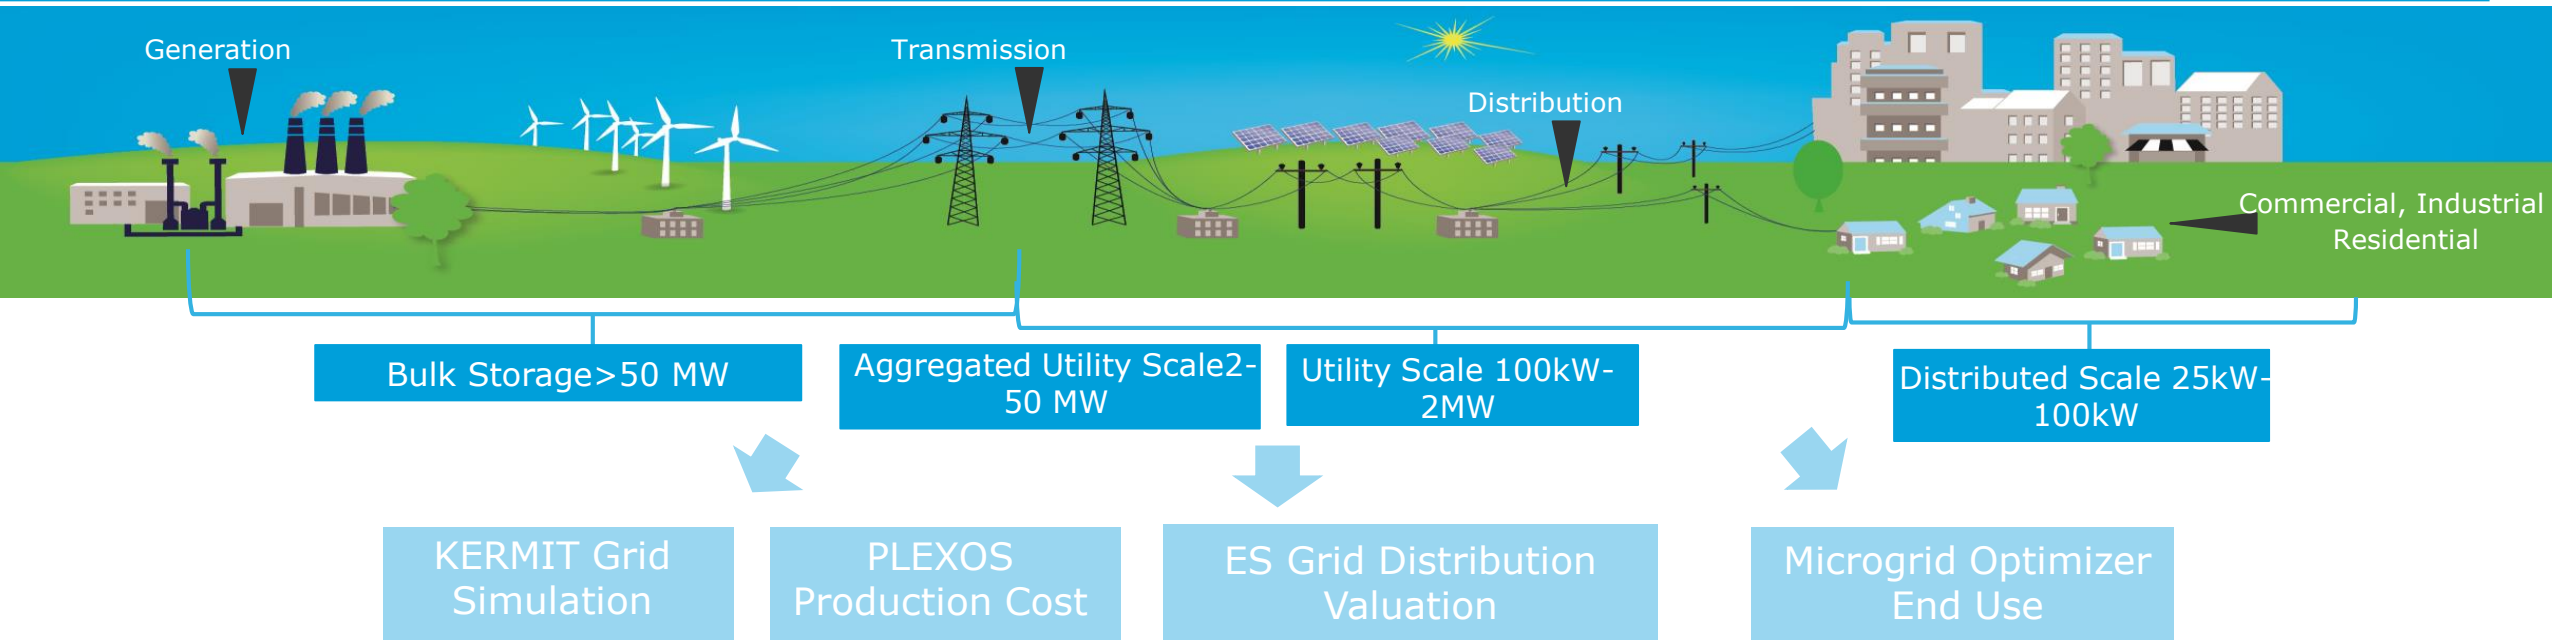

## Bulk Storage Applications

- Large renewable support – shifting, smoothing or firming
- Fossil generation support
- Contingency Reserve, Resource adequacy

## Utility Scale Applications

- Distribution circuit upgrade deferral
- PV Smoothing

## Customer Scale Applications

- Customer bill management
- Outage mitigation


# Advanced Application Modeling

## Solar Self-Supply

# Solar Self-Supply

- Excessive PV penetration and production is creating grid and system issues
  - Circuit back-feed, excessive ramping.
- Net-metering is replaced by:
  - Self supply (solar + storage)
  - Expedited interconnection
  - Energy sell-back to grid is forbidden and not compensated
  - Grid supply
    - Limited sell-back to grid is allowed at highly reduced rates
- Similar situations expected to arise as distribution installed renewable penetration increases, e.g. CA, NY

## Trending Hi-Pen Circuits (12kV) – Loch Ness Profile

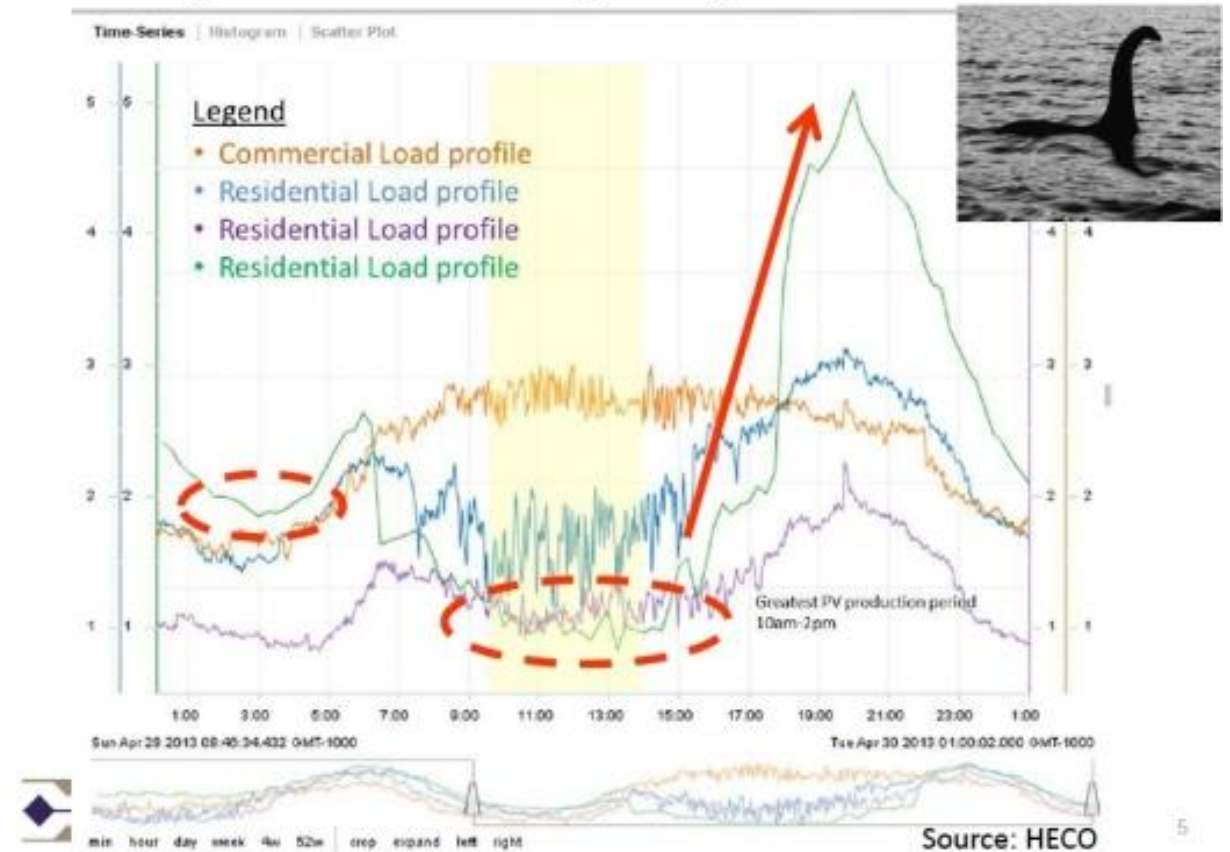


# Solar Self-Supply – Storage Dispatch Strategy

---

- Battery is charged whenever PV production is greater than load
  - excess solar is curtailed
- Key challenge is to appropriately size solar+storage w.r.t. customer load such that:
  - Maximize solar utilization
  - Maximize energy storage throughput

# Residential Self-Supply Operational Example

- Example residential customer
  - Peak demand: 6.25 kW-1min  
4.84 kW-15min
  
- DER Installed:
  - PV: 6kW-dc
  - Storage: 3.3 kW, 4 hours
  
- Grid supply is required only between midnight and 8 am
  - Without storage: 48.1% PV curtailment over 24 hours
  - With storage: 7.5% PV is curtailment

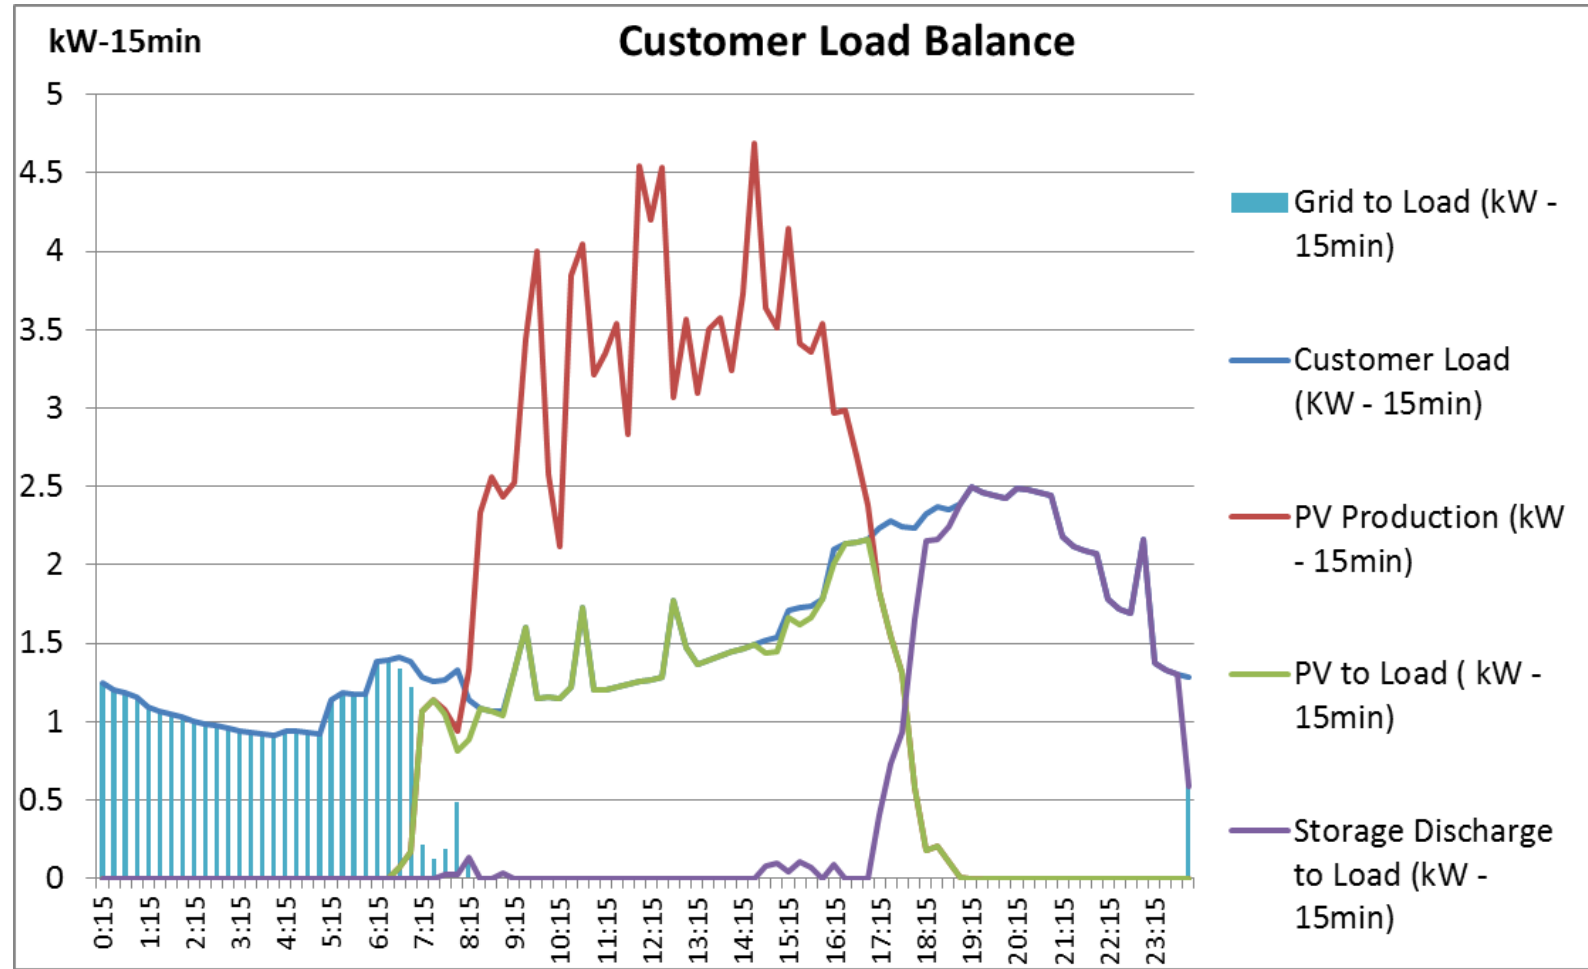


*15-min operations shown for clarity*



# Residential Self-Supply Resource Sizing Optimization - Financial

- 20 year cash-flow analysis considering O&M costs, ITC rebates, battery replacement on 10<sup>th</sup> year.
- PV cost \$3,200 per kW
- Storage cost:
  - \$460/kWh for battery
  - \$450/kW for inverter
  - \$1500 for installation

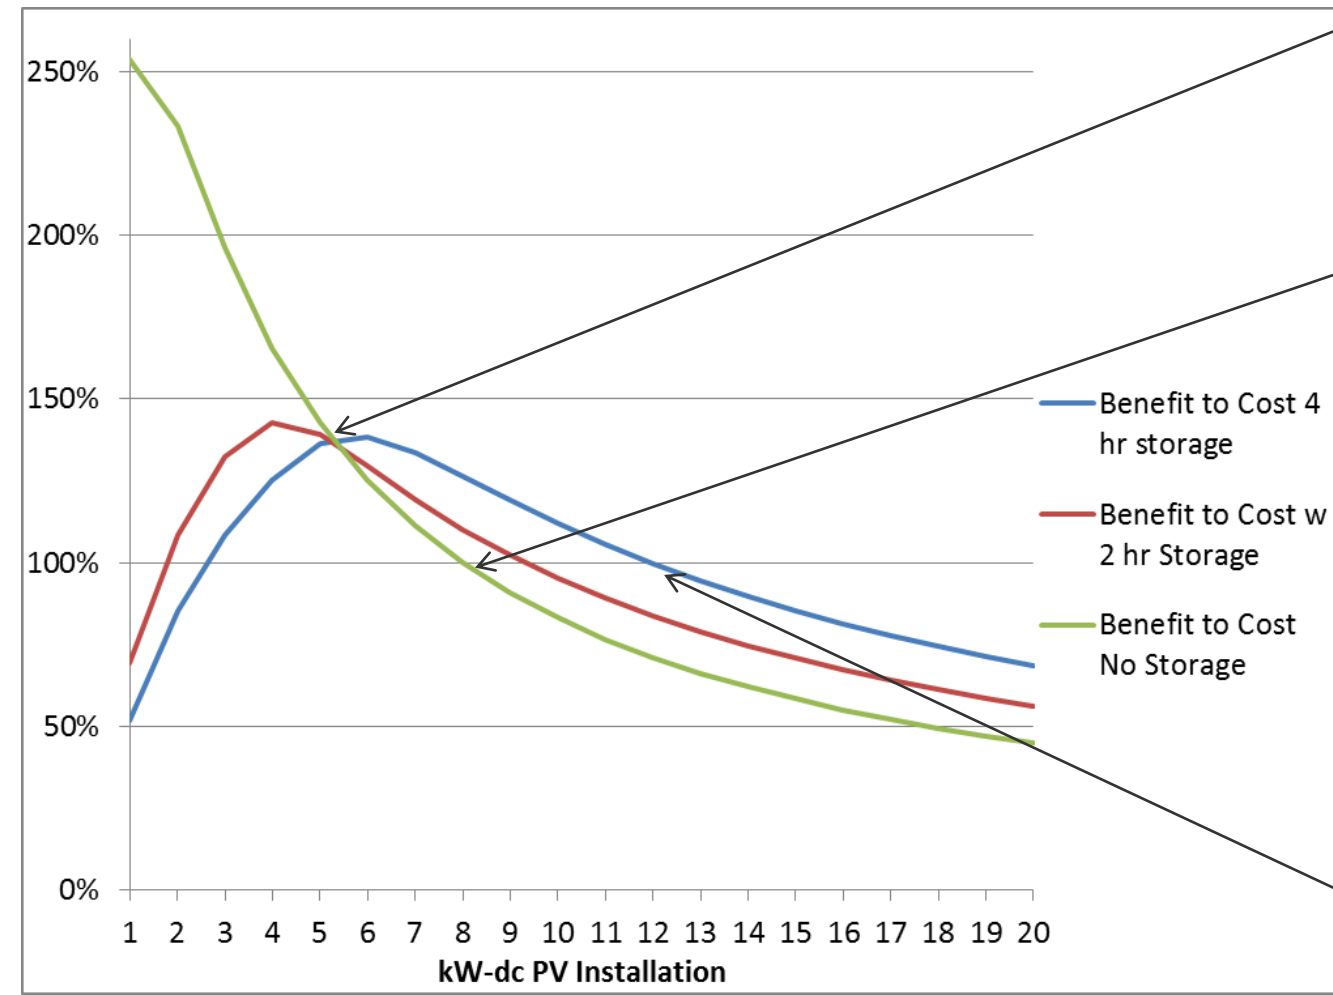

*Above 6 kW-dc PV, Solar + Storage is more cost-effective than stand-alone Solar*

*Stand-alone PV cost-effective up to 8 kW*

*Solar + Storage is cost-effective till 12 kW PV (BCR > 100%)*

# Advanced Application Modeling

Demand Charge Reduction + Fast Regulation

# Demand Charge Reduction + Regulation

---

- Nearest term application for behind-the-meter storage to participate in wholesale markets
- Pilot projects recently funded in CA, NY and NJ.
- Proceedings underway in CA and NY to provide (generation side) wholesale market access to behind-the-meter resources.
- FERC recently opened Docket No. AD16-25 to investigate storage compensation for bundling applications in wholesale, transmission and BTM markets
  - *"...FERC's announcement also recognizes the importance of distributed energy storage in wholesale markets. The Commission is seeking input on how distributed and customer-sited storage systems are able to provide local benefits while simultaneously providing competitive wholesale market services, which is currently possible to a limited degree in California."*


- Newswire, Oct 3<sup>rd</sup>, 2016

# DCR + Fast Regulation – Storage Dispatch Strategy

---



- Customer bill management application is assigned priority
- Available capacity after bill management is then committed to regulation
- Regulation participation performed while minimizing impact on customer quality of service
  - Controls need to manage SoC so regulation participation does not impact bill management
  - SoC offsets result from lack of a net-zero regulation signal

# Demand Charge Reduction Operation – Secondary School


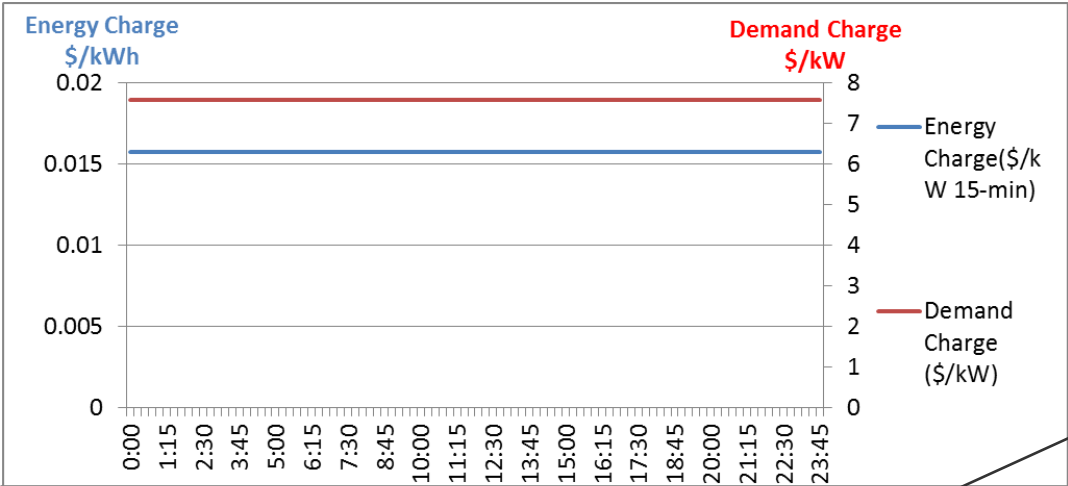


- Example day – July 14
- Charges are low:
  - 6.3 /kWh, \$7.15/kW.

*Storage compensates PV intermittency and flattens load*

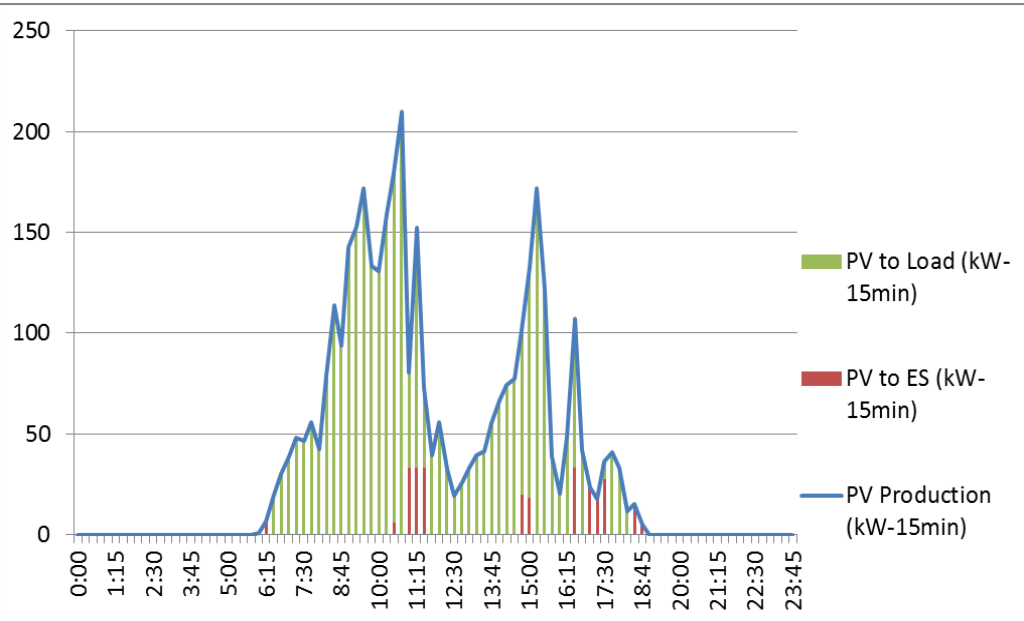
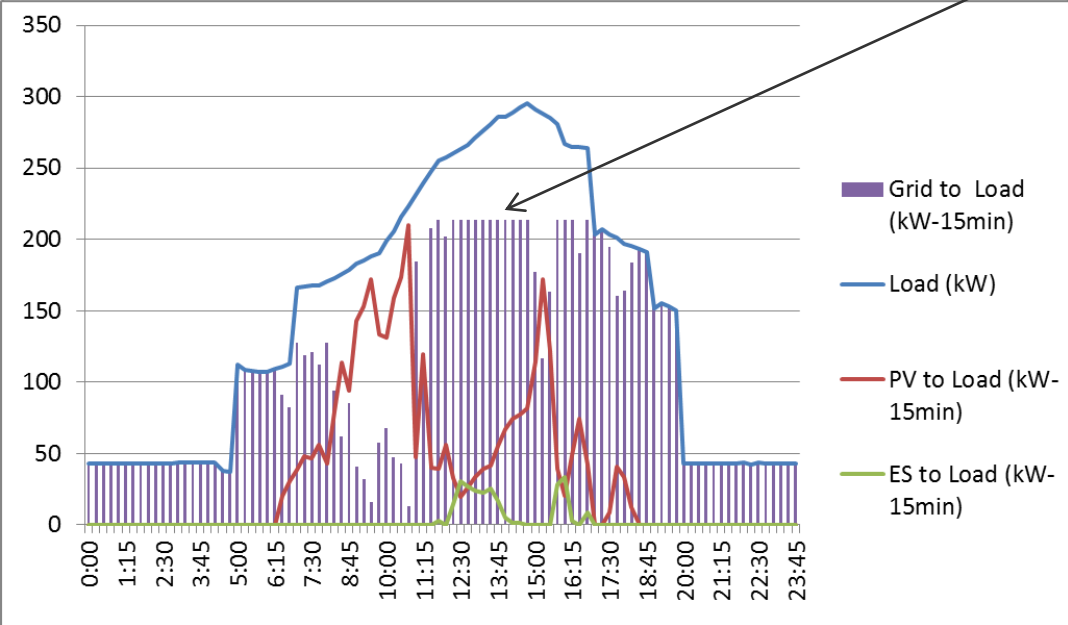


# Storage Setpoints and Regulation Commitment

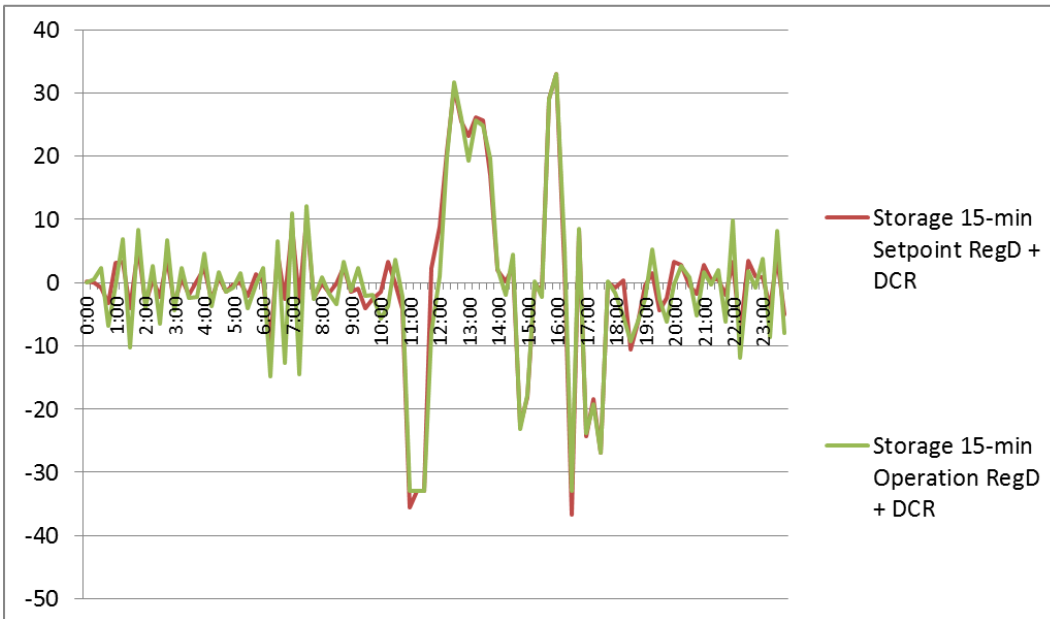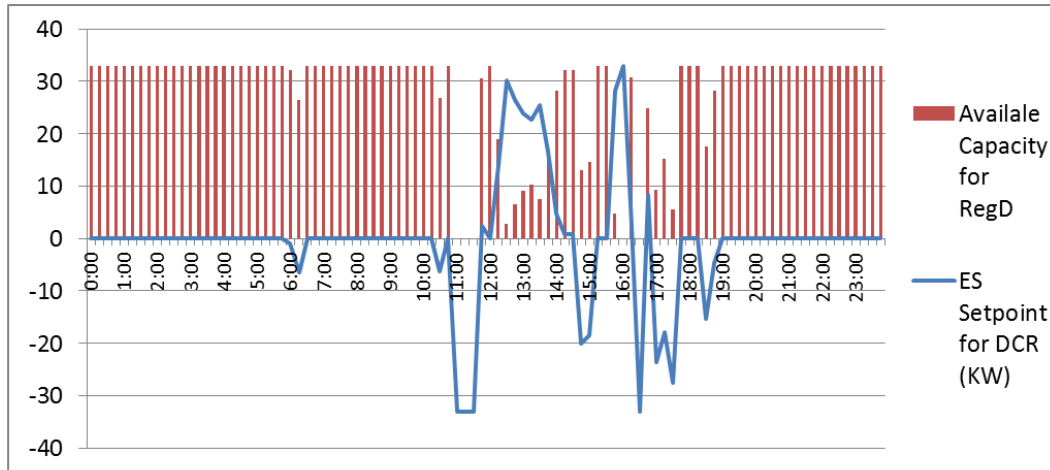


- Regulation commitment is based on capacity availability after bill management.
- Reg-D set-points calculated every 15-mins based on energy compensation requirements
- Actual operation shows energy transaction while following RegD signal during the 15-min interval from set-point.

# Daily Operation Results

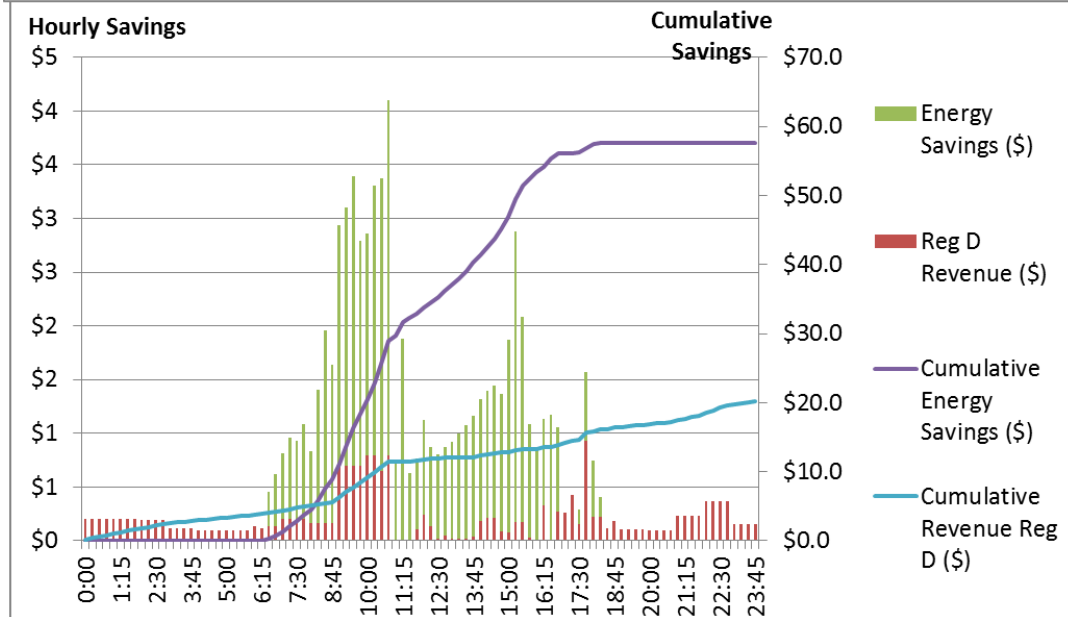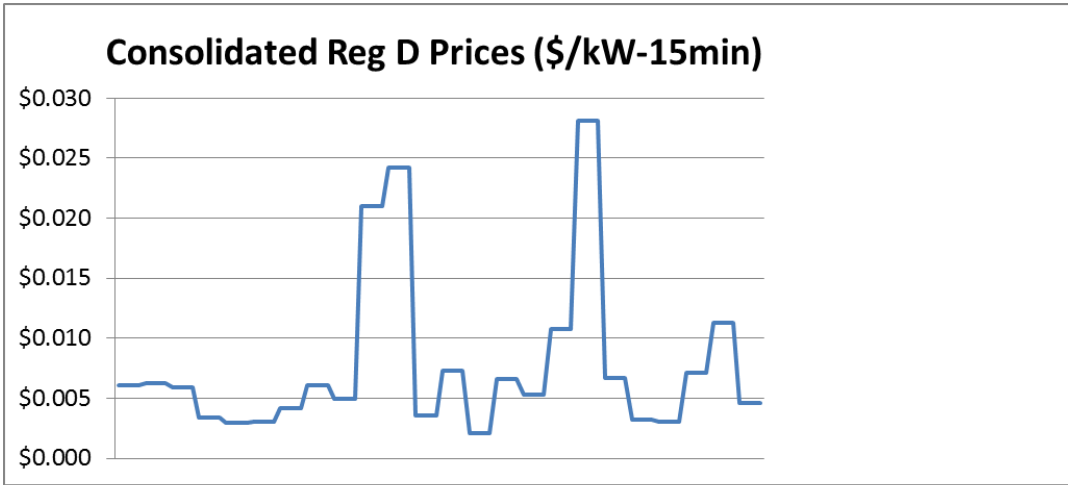

- Cumulative savings over day
  - \$58 from energy (PV)
  - \$20 from regulation
- Effect on net-load over day is minimal

*Peak demand increases slightly over the day*

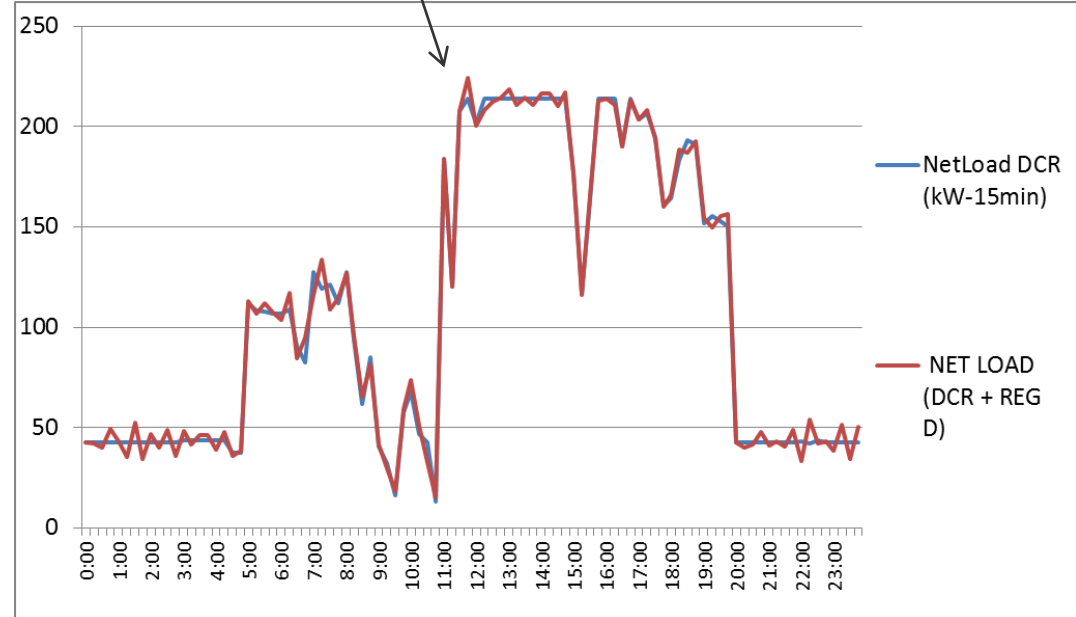

# Financial Impact of Combining Applications

Demand Charge Reduction Payback

	Utility	Storage Cost	Storage Benefit	Payback Period (yrs)
Secondary School	JCPL	\$33,747	\$2,131	16
Secondary School	PSE&G	\$33,747	\$1,540	22
Retail	JCPL	\$14,059	\$795	18
Retail	PSE&G	\$14,059	\$609	23

*Combining applications enables cost-effective storage where tariffs not suited for individual applications.*

Demand Charge Reduction + Regulation Payback

	Utility	Storage Cost	Storage Benefit (DCR)	Storage Benefit (RegD)	RegD impact on energy charge savings	RegD impact on demand charge savings	Reg D impact on net metering revenue	Reg D impact on BM Benefits	Final Storage Benefits	Payback Period (yrs)
Secondary School	JCPL	\$33,747	\$2,131	\$9,238	(\$317)	(\$810)	(\$16)	(\$1,143)	\$10,226	3
Secondary School	PSE&G	\$33,747	\$1,540	\$9,238	(\$657)	(\$276)	(\$33)	(\$966)	\$9,812	3
Retail	JCPL	\$14,059	\$795	\$3,714	(\$151)	(\$547)	(\$24)	(\$722)	\$3,786	4
Retail	PSE&G	\$14,059	\$609	\$3,714	(\$151)	(\$547)	(\$24)	(\$722)	\$3,601	4



# Thank You!

**Michael Kleinberg**

michael.kleinbergr@dnvgl.com

+1 215 589 4178

**www.dnvgl.com**

**SAFER, SMARTER, GREENER**